TWIN CITY HOSE, INC.

UL CLASSIFIED MH59973

UL SS U LOOP FLANGE 3"

Lead-Free Flex™

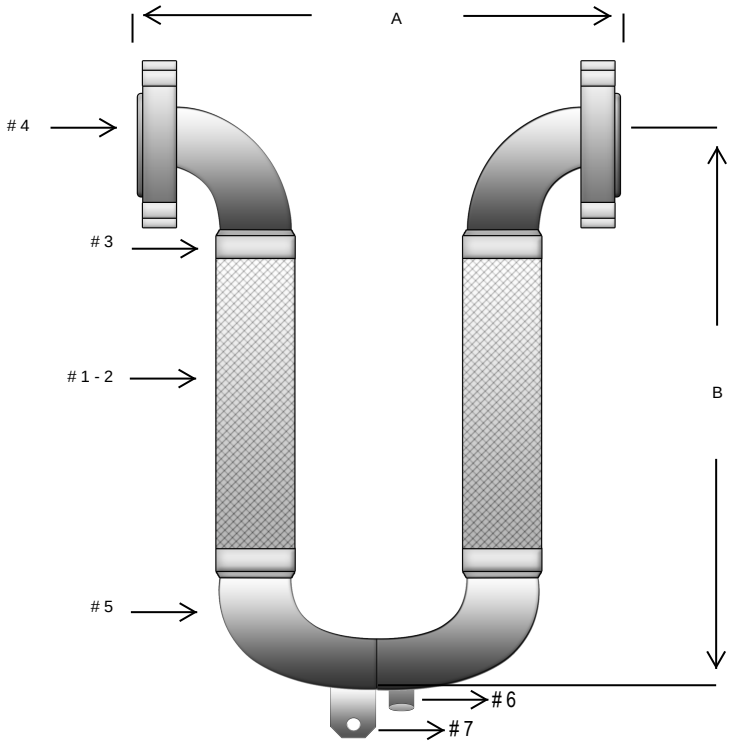

CLASSIFIED C UL US
WATER QUALITY
DRINKING WATER SYSTEM COMPONENT
NSF/ANSI 61, NSF/ANSI 372
MH59973

BUY AMERICAN ACT COMPLIANT

MATERIALS

#1-2 HOSE & BRAID: T-321 STAINLESS STEEL HOSE WITH 1-LAYER OF T-304 STAINLESS STEEL BRAID

#3 BRAID BAND: T-304 STAINLESS STEEL

#4 END FITTING: 150# STAINLESS STEEL RAISED FACE SLIP ON FLANGE

#5 ELBOWS: STAINLESS STEEL

6 DRAIN PORT (OPTIONAL): ☐

7 HANGER (OPTIONAL): ☐

*12" UD AND LARGER ARE SCHEDULE STANDARD (STD)

QTY	MODEL NUMBER	SIZE	"A" DIM.	"B" DIM.	MAX WRK. PSIG	MAX TEST	@ TEMP.	LATERAL OFFSET	WT. LBS.
	UL-SL200493	2"	16 ½"	24 ¼"	500	750	70°F	3"	19
	UL-SL250493	2 ½"	18 ¾"	26 ½"	400	600	70°F	3"	30
	UL-SL300493	3"	18 ¾"	29 ¾"	288	431	70°F	3"	38
	UL-SL400493	4"	24 ¾"	35 ¼"	250	375	70°F	3"	61
	UL-SL500493	5"	30 ¾"	40 ½"	200	300	70°F	3"	96
	UL-SL600493	6"	36 ¾"	46 ½"	175	263	70°F	3"	139
	UL-SL800493	8"	48 ¾"	57"	212	318	70°F	3"	280
	UL-SL010493	10"	61"	67 ¼"	175	263	70°F	3"	455
	UL-SL012493	*12"	73"	77"	160	240	70°F	3"	668

TEMPERATURE DERATING FACTORS: MULTIPLY X WRK. PSIG							
200° F	250° F	300° F	350° F	400° F	500° F	600° F	700° F
0.94	0.92	0.88	0.86	0.83	0.78	0.74	0.7

DRAWN BY: _____ **DRAWING NUMBER:** _____ **REV:** _____

SIGNATURE: _____ **DATE:** _____

PO NUMBER: _____ **PROJECT:** _____

CUSTOMER: _____ **NOTES:** _____

20615 Commerce Blvd., Rogers, MN 55374 P 1-800-670-9475 F 763-428-5111 E sales@twincityhose.com W www.twincityhose.com