UL CLASSIFIED MH59973

UL U LOOP WELD END 4"

TWIN CITY HOSE, LLC.

Lead-Free Flex™

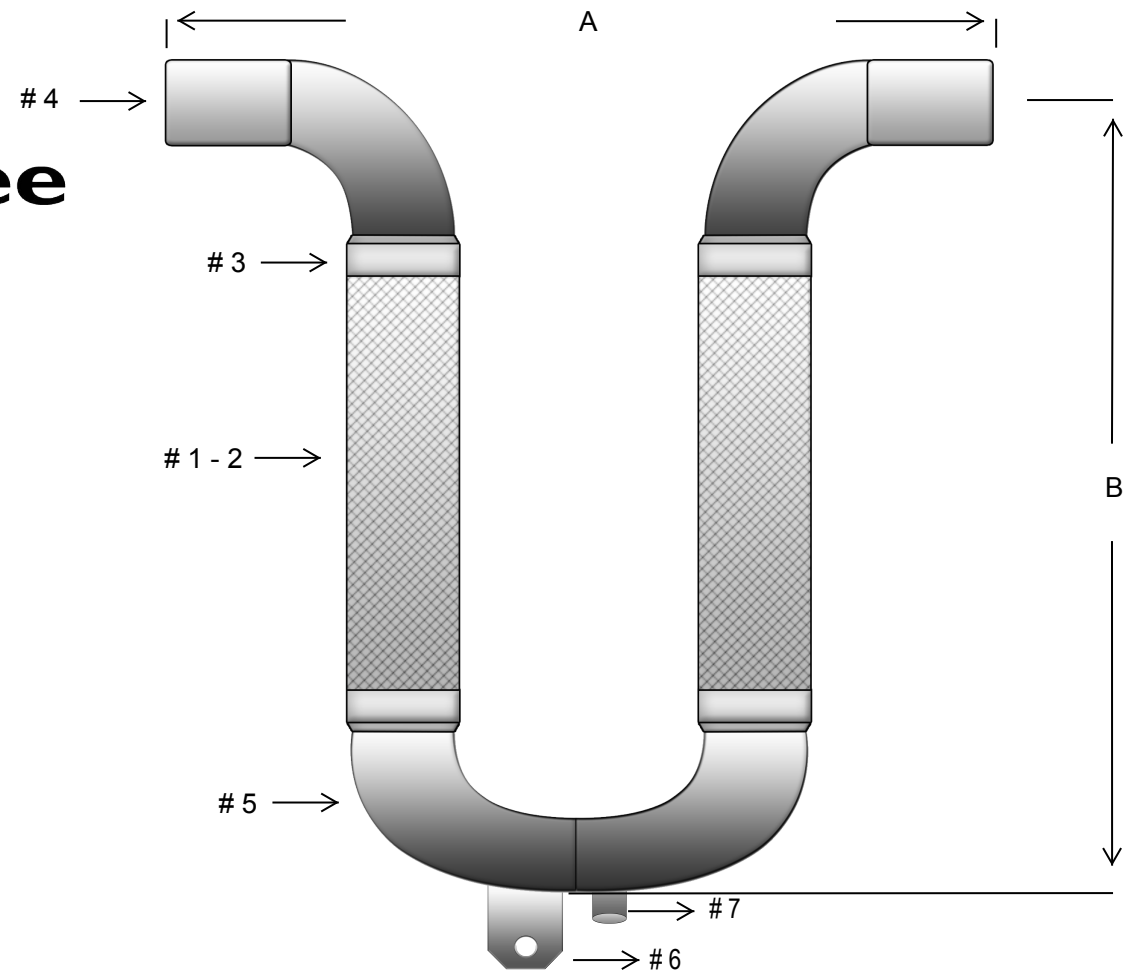

CLASSIFIED C UL US

WATER QUALITY

DRINKING WATER SYSTEM COMPONENT
NSF/ANSI 61, NSF/ANSI 372

MH59973

MATERIALS

#1-2 HOSE & BRAID: T-321 STAINLESS STEEL HOSE WITH 1-LAYER OF T-304 STAINLESS STEEL BRAID

#3 BRAID BAND: T-304 STAINLESS STEEL

#4 END FITTING: SCH. 40 CARBON STEEL WELD ENDS

#5 ELBOWS: SCH. 40 CARBON STEEL

#6 HANGER *12" ID AND LARGER ARE SCHEDULE STANDARD (STD)

7 DRAIN PORT (OPTIONAL): ☐

QTY	MODEL NUMBER	SIZE	"A" DIM.	"B" DIM.	MAX WRK. PSIG	MAX TEST	@ TEMP	LATERAL OFFSET	WT. LBS.
	UL-SL200284	2"	24"	26 ¾"	500	750	70°F	4"	11
	UL-SL250284	2 ½"	26"	29"	400	600	70°F	4"	19
	UL-SL300284	3"	25"	32 ½"	288	431	70°F	4"	26
	UL-SL400284	4"	32"	38 ½"	250	375	70°F	4"	45
	UL-SL500284	5"	37"	44"	200	300	70°F	4"	75
	UL-SL600284	6"	42"	50 ¼"	175	263	70°F	4"	116
	UL-SL800284	8"	56"	61 ¼"	212	318	70°F	4"	235
	UL-SL010284	10"	68"	72"	175	263	70°F	4"	402
	UL-SL012284	*12"	80"	82 ¼"	160	240	70°F	4"	586

TEMPERATURE DERATING FACTORS: MULTIPLY X WRK. PSIG							
200° F	250° F	300° F	350° F	400° F	500° F	600° F	700° F
0.94	0.92	0.88	0.86	0.83	0.78	0.74	0.7

DRAWN BY: _____ **DRAWING NUMBER:** _____ **REV:** _____

SIGNATURE: _____ **DATE:** _____

PO NUMBER: _____ **PROJECT:** _____

CUSTOMER: _____ **NOTES:** _____

20615 Commerce Blvd., Rogers, MN 55374 P 1-800-670-9475 F 763-428-5111 E sales@twincityhose.com W www.twincityhose.com